

DO NOT SCALE DRAWING

TOLERANCES (UNLESS NOTED)	DRAWN	CHECKED	CHECKED	SCALE
DECIMALS = 1/16 inch / mm	C. Whan	Vg	W. Tchan	NONE
X ±.1 12.54	8/10	8/10	8/10	
.XX ±.01 0.25				
XXX ±.005 0.125				
HOLES ±.003 0.080				
ANGLES ±1/2°				

CATEGORY CONTROL DRAWING

TG300 SERIES INSTALLATION DIAGRAM, ATEX


DRAWING NUMBER **TG300-ATEX** SHEET 1 of 2 REVISION **B**

REVISED BY	DATE	BY	APPROVAL
ECO 16177	1/11	CW	<i>CB</i>

NOTICE RE PROPRIETARY INFORMATION: This drawing and the information contained herein are the proprietary property of Moore Industries International, Inc. (MII) and should not be reproduced or disclosed to any third party without the written consent of an authorized officer of MII.

NON-HAZARDOUS AREA

HAZARDOUS AREA ZONE 1

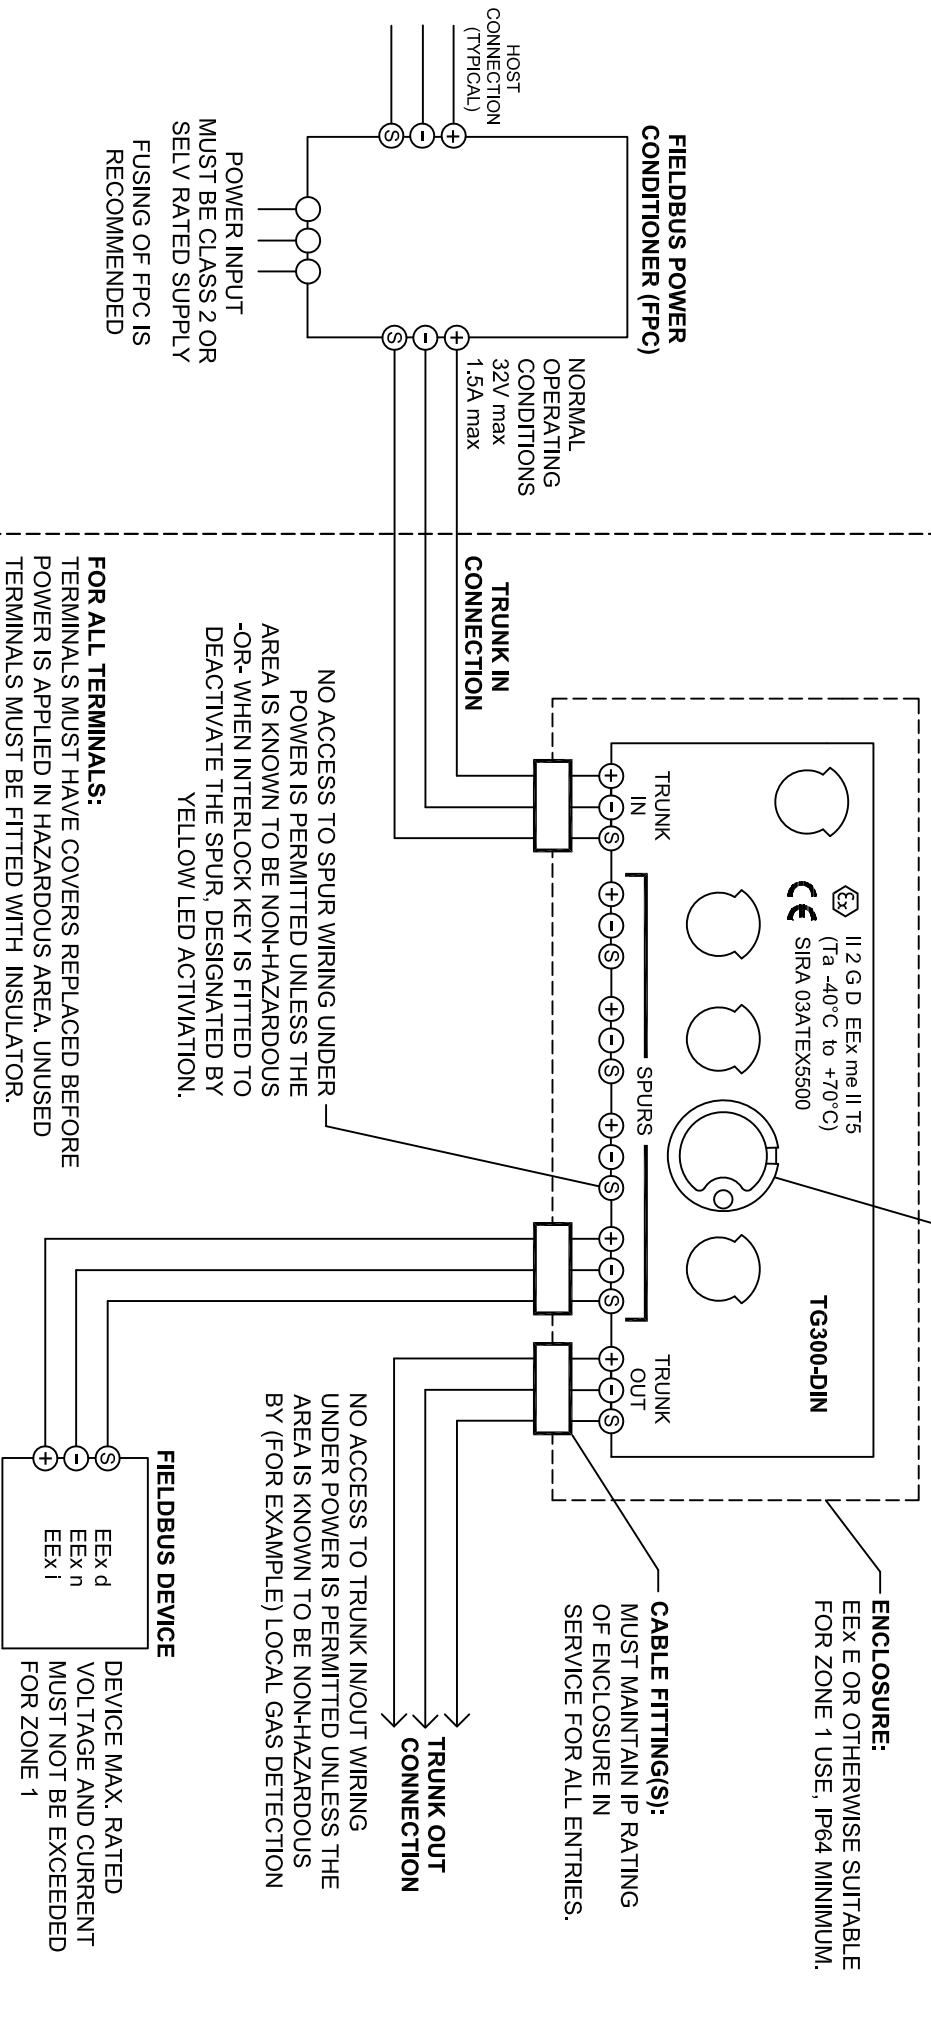

WHERE ENGLISH IS NOT A LANGUAGE OF THE COUNTRY IN WHICH THE EQUIPMENT IS BEING USED, PLEASE APPLY TO MooreHawke FOR A SUITABLE TRANSLATION.

IF ANY OTHER CIRCUITS PRESENT, THEY SHALL BE SUITABLY APPROVED FOR THE HAZARDOUS AREA OF INSTALLATION AND WHEN ENCLOSURE IS OPENED, ALL LIVE PARTS SHALL BE PROTECTED TO IP30 MINIMUM.

INSTALLATION MAY ONLY BE CARRIED OUT BY SUITABLY TRAINED PERSONNEL AND IN ACCORDANCE WITH NATIONAL WIRING REGULATIONS OR CODES OF PRACTICE. USER REPAIR OF TG300-DIN UNIT IS NOT POSSIBLE.

DO NOT SCALE DRAWING

TOLERANCES (UNLESS NOTED)	
X	$\pm 1/16$ 12.54
.XX	± 0.01 0.25
XXX	± 0.005 0.125
HOLES	± 0.005 0.080
ANGLES	$\pm 1/12^\circ$

DRAWN		TITLE	
C. Whan	8/10	CONTROL DRAWING	
CHECKED		See Sht.1	TG300 SERIES INSTALLATION DIAGRAM, ATEX
CHECKED		See Sht.1	
SCALE		NONE	

CATEGORY CONTROL DRAWING


DRAWING NUMBER **TG300-ATEX** SHEET 2 of 2 REVISION **B**

REVISED BY SEE SHEET 1 DATE BY APPROVAL

NOTICE RE PROPRIETARY INFORMATION: This drawing and the information contained herein are the proprietary property of Moore Industries International, Inc. (MII) and should not be reproduced or disclosed to any third party without the written consent of an authorized officer of MII.

NON-HAZARDOUS AREA

HAZARDOUS AREA ZONE 2

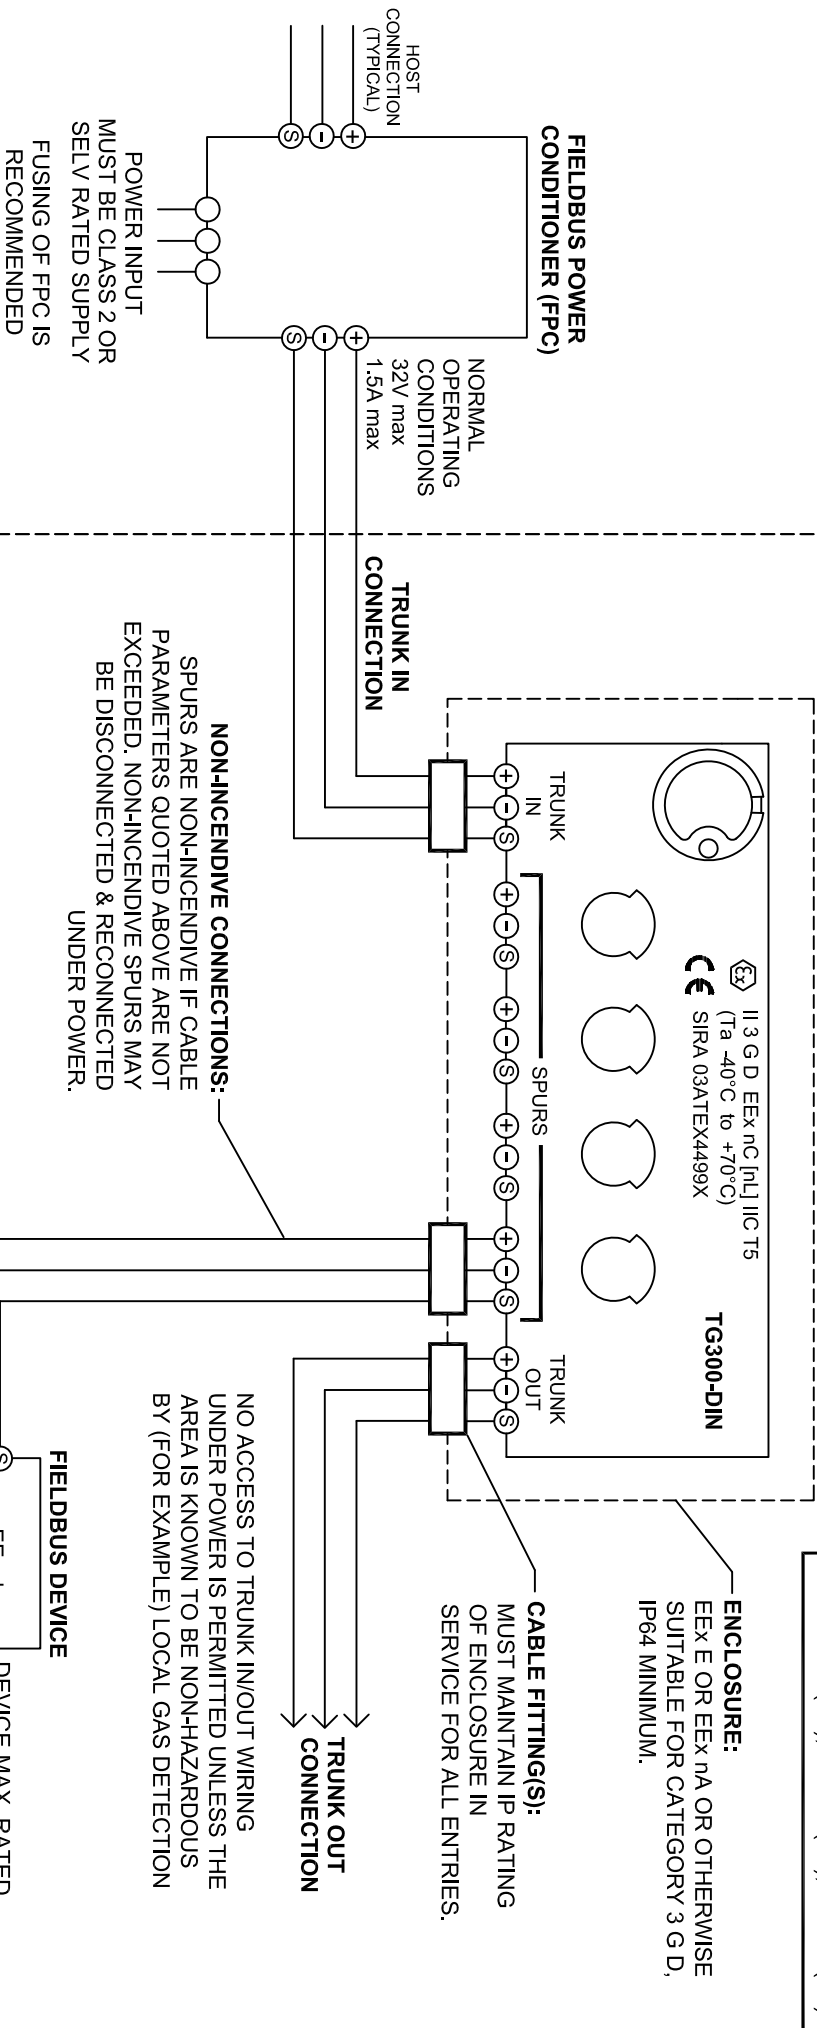

WHERE ENGLISH IS NOT A LANGUAGE OF THE COUNTRY IN WHICH THE EQUIPMENT IS BEING USED, PLEASE APPLY TO MooreHawke FOR A SUITABLE TRANSLATION.

IF ANY OTHER CIRCUITS PRESENT, THEY SHALL BE SUITABLY APPROVED FOR THE HAZARDOUS AREA OF INSTALLATION AND WHEN ENCLOSURE IS OPENED, ALL LIVE PARTS SHALL BE PROTECTED TO IP30 MINIMUM.

INSTALLATION MAY ONLY BE CARRIED OUT BY SUITABLY TRAINED PERSONNEL AND IN ACCORDANCE WITH NATIONAL WIRING REGULATIONS OR CODES OF PRACTICE. USER REPAIR OF TG300-DIN UNIT IS NOT POSSIBLE.

FOR ALL TERMINALS:
TERMINALS MUST HAVE COVERS REPLACED BEFORE POWER IS APPLIED IN HAZARDOUS AREA. UNUSED TERMINALS MUST BE FITTED WITH INSULATOR.

MAINTAIN MINIMUM CLEARANCE OF 1 mm BETWEEN LIVE PARTS AND EARTHED METAL.